

PRODUCT DESCRIPTION

SPECTEC's Intrinsically Safe preamplifier for passive magnetic VRS sensors is designed for installation in hazardous locations. The 'ELBY' housing type will fit in ELBY50 and ELBY75 explosion proof junction boxes. The 'A' housing type will fit in a GAUL-16 or similar standard explosion proof junction box.

INSTALLATION

CAUTION: This sensor MUST be installed with an FM approved barrier and following the details specified in the Installation Instruction Document #85049.

SPECIFICATIONS

Supply Voltage & Current: 7.5-30Vdc @ $\leq 3\text{mA}$ for 0-5Vo
11-30Vdc @ $\leq 12\text{mA}$ for 0-10Vo
3.6Vdc min. @ $\leq 20\text{mA}$ for 0-Vs

Output Voltage: See below
(R Load $>20\text{k}\Omega$)

Frequency Range: ~5 Hz to 10 kHz
Up to 40 kHz with increased signal

Input Sensitivity: See below

Construction: Plastic housing
Solid Epoxy Encapsulation

TERMINAL CONNECTIONS

- | | |
|--------------------|--------------------------|
| 1 - Supply Voltage | 4 - Mag Sensor (IS only) |
| 2 - Common | 5 - Mag Sensor (IS only) |
| 3 - Output Signal | (see IS40 & IS41) |

FEATURE SELECTION

- IS4022 -** ☐ ☐ Mag Preamp (US & Canada)
IS4022A - ☐ ☐ Mag Preamp (ATEX, UKEX, & IECEx)

- Output Signal**
- 1 - 0-5V, NPN
 - 2 - 0-10V, NPN
 - 3 - 0-Vs, NPN
 - 4 - 0-Vs, NPN, OC
 - 5 - Selectable: 0-5V, NPN
 - 0-10V, NPN
 - 0-Vs, NPN, OC
 - 6 - 0-Vs, PNP, OC


- Input Sensitivity**
- 0 - 30 mVpp (Standard)
 - 1 - 12 mVpp (High)

For 'A' housing type add 'A' as a prefix to the P/N suffix:
(e.g. IS4022-Axx)


Similarly for the ATEX, UKEX, & IECEx version:
(e.g. IS4022A-Axx)

For explosion proof junction box refer to bulletin 4001.

'ELBY' housing type

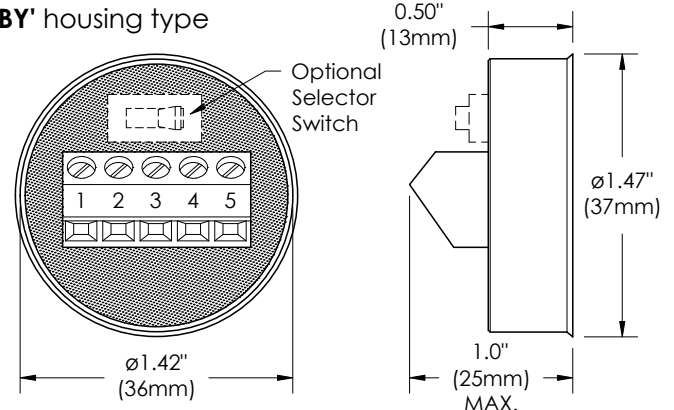

'A' housing type (mountable)

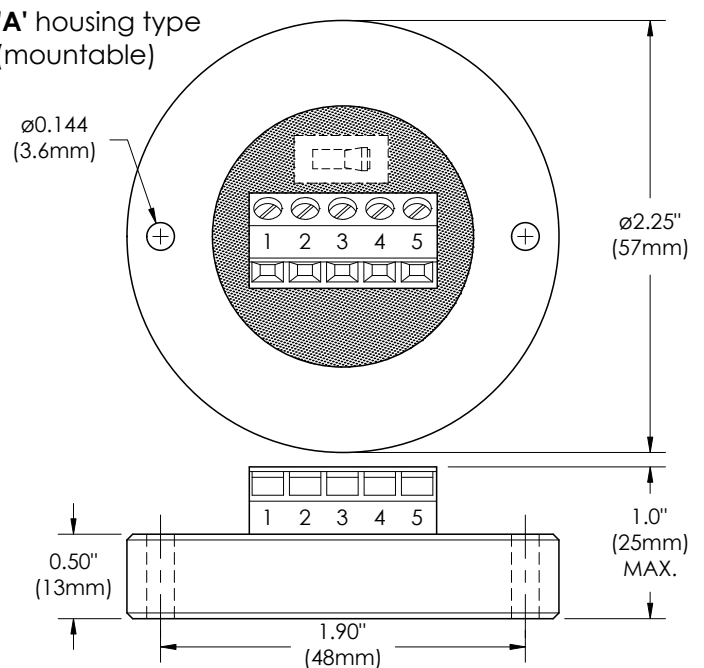

CERTIFICATIONS for IS4022

USA:

Intrinsically Safe
Class I, II, III, Division 1
GROUP ABCDEFG T6...T4
Class I, Zone 0, AEx ia IIC T6...T4



Canada:

Intrinsically Safe
Class I, Division 1, GROUP ABCD T6...T4
Class I, Zone 0, Ex ia IIC T6...T4

T4 @ $-40^{\circ}\text{C} \leq T_{\text{amb}} \leq +85^{\circ}\text{C}$
T5 @ $-40^{\circ}\text{C} \leq T_{\text{amb}} \leq +80^{\circ}\text{C}$
T6 @ $-40^{\circ}\text{C} \leq T_{\text{amb}} \leq +60^{\circ}\text{C}$

CERTIFICATIONS for IS4022A

ATEX & UKEX:



CE:



IECEx:



II 1 G Ex ia IIC T6...T4 Ga
FM08ATEX0068X
FM22UKEX0110X

Compliance with
EN50081-1, EN50082-1

Ex ia IIC T6...T4 Ga
IECEx FMG 16.0003X

T4 @ $-40^{\circ}\text{C} \leq T_{\text{amb}} \leq +85^{\circ}\text{C}$
T5 @ $-40^{\circ}\text{C} \leq T_{\text{amb}} \leq +80^{\circ}\text{C}$
T6 @ $-40^{\circ}\text{C} \leq T_{\text{amb}} \leq +60^{\circ}\text{C}$

